

Full Color Capacitive Touch Panel with 7" Display

ZVIZ70V2 **TECHNICAL DOCUMENTATION**

FEATURES

- 7" full-color capacitive touch panel (1280x800 pixels)
- 16 million color LCD display
- Proximity and luminosity sensor
- Loudspeakers for acoustic notifications
- Thermostat
- Optional features according to the license type (sold separately): Remote control from app, video intercom and internal calls
- 4 analog/digital inputs
- Built-in temperature probe
- External 24-29 VDC power supply
- Micro-USB connection for firmware update and additional functionalities
- Ethernet connection
- Total data saving on KNX bus failure
- Integrated KNX BCU (TP1-256)
- Dimensions 189 x 137 x 37 mm (it protrudes 11.8 mm from the wall)
- Flush mount on double European and double British standard mounting box
- Conformity with the CE, UKCA, RCM directives (marks on the back side)

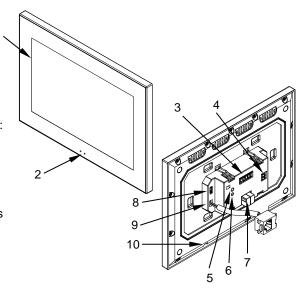


Figure 1: Z70 v2

| 1. Touch screen | Luminosity and p | roximity sensor | 3. Inputs of | connector | Power input | Programming button |
|--------------------|------------------------------------|-----------------|--------------|------------|-------------------------------|--------------------------------------|
| 6. Programming LED | KNX connector | 8. Micro-USB | connector | 9. Etherne | et connector | 10. Temperature probe |

Programming button: short press to set programming mode. If this button is held while plugging the device into the KNX bus, it enters the safe mode.

Programming LED: programming mode indicator (red). When the device enters the safe mode, it blinks (red) every half second. During the start-up (reset or after KNX bus failure) and if the device is not in safe mode, it emits a red flash.

| | SPECIFICATION | JNS | DECORIDETION | | | |
|-----------------------------|--------------------|---|--|------------|--|--|
| CONCEPT | | | DESCRIPTION | | | |
| Type of device | | | Electric operation control device | | | |
| Voltage (typical) | | | 29 VDC SELV | | | |
| KNX supply Ma | Voltage range | | 21-31 VDC | | | |
| | Maximum | Voltage | mA | mW | | |
| | consumption | 29 VDC (typical) | 5 | 145 | | |
| | | 24 VDC ¹ | 10 | 240 | | |
| | Connection ty | pe | Typical TP1 bus connector for | | | |
| External power supply | | 24-29 VDC. Maximum consum | 24-29 VDC. Maximum consumption: 375 mA (24 VDC) - 300 mA (29 VDC). | | | |
| Operation temperature | | 5 +45 °C | 5 +45 °C | | | |
| Storage temp | erature | | -20 +55 °C | -20 +55 °C | | |
| Operation humidity | | 5 95% | 5 95% | | | |
| Storage humidity | | 5 95% | 5 95% | | | |
| Complementa | ary characteristic | cs | Class B | Class B | | |
| Protection cla | ISS | | III | | | |
| Operation type | | Continuous operation | | | | |
| Device action type | | Type 1 | | | | |
| Electrical stress period | | Long | | | | |
| Degree of protection | | IP20, clean environment | | | | |
| Installation | | With flush-mounted back box and fixing through pressure clips | | | | |
| Minimum clearances | | Not required | | | | |
| Response on KNX bus failure | | Data saving according to parameterization | | | | |
| Response on KNX bus restart | | Data recovery according to parameterization | | | | |
| Operation indicator | | The programming LED indicates programming mode (red). Backlighting of | | | | |
| · | | the display depending on the parameterization. | | | | |
| Weight | | 470 g | | | | |
| PCB CTI index | | 175 V | 1101 | | | |
| Housing material | | PC+ABS FR V0 halogen free | PC+ABS FR V0 halogen free | | | |


¹ Maximum consumption in the worst-case scenario (KNX Fan-In model).

| INPUTS SPECIFICATIONS AND CONNECTIONS | | | |
|---------------------------------------|--|--|--|
| CONCEPT | DESCRIPTION | | |
| Number of inputs | 4 | | |
| Inputs per common | 4 | | |
| Operation voltage | +3.3 VDC in the common | | |
| Operation current | 1 mA @ 3.3 VDC (per input) | | |
| Switching type | Dry voltage contacts between input | | |
| Switching type | and common | | |
| Connection method | Pluggable screw terminal block | | |
| Connection method | (0.3 Nm max.) | | |
| Cable cross-section | 0.2-1 mm ² (IEC) / 26-16 AWG (UL) | | |
| Maximum cable length | 30 m | | |
| NTC probe length | 1.5 m (extensible up to 30 m) | | |
| NTC accuracy (@ 25 °C) ² | ±0.5 °C | | |
| Temperature resolution | 0.1 °C | | |
| Maximum response time | 10 ms | | |

² For Zennio temperature probes.

INPUTS CONNECTION

Any combination of the following accessories is allowed in the inputs:

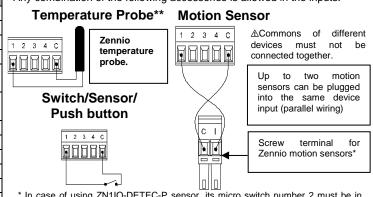

^{*} In case of using ZN1IO-DETEC-P sensor, its micro switch number 2 must be in Type B position.


^{**}Zennio temperature probe or any NTC with known resistance values at three points in the range [-55, 150 °C].

| EXTERNAL POWER SUPPLY AND PORTS SPECIFICATIONS AND CONNECTIONS | | |
|--|---|--|
| CONCEPT | DESCRIPTION | |
| Voltage | 24-29 VDC | |
| Current | 375 mA (24 VDC) - 300 mA (29 VDC) | |
| Connection method | Pluggable screw terminal block (0.3 Nm max.) | |
| Cable cross-section | 0.2-1 mm ² (IEC) / 26-16 AWG (UL) | |
| USB connector | Micro USB Type B connector. Use it only for the functionality specified in the manual. | |
| | Do not connect neither to PC, hard drives nor other devices whose consumption is over 150 mA. | |
| Ethernet Connector | RJ-45 female connector | |

| INTERNAL TEMPERATURE SENSOR SPECIFICATIONS | | |
|--|--|--|
| CONCEPT | DESCRIPTION | |
| Measuring range | -10 50 °C | |
| NTC accuracy (@ 25 °C) ² | ±0.5 °C | |
| Temperature resolution | 0.1 °C | |
| Calibration | The temperature sensor should be calibrated through the application program. Moreover, to avoid fluctuations in the temperature measurement, the flush-mounted box must be completely sealed once the cables are inside. Airtight boxes, polyurethane foam, silicone rubber or similar non-breathable construction materials can be used. It is not recommended to use this temperature sensor for a thermostatic control. | |

INSTALLATION INSTRUCTIONS

- 1. Fix the metal plate into a double back box by using the screws from the box, checking that it is levelled.
- 2. Connect the KNX bus, the Ethernet, the power supply and the inputs terminal to the back of the device.
- 3. Fit the device into its final position and check that the strength of the clips is enough to fix the device. Check that the metal plate is completely hidden by the device.

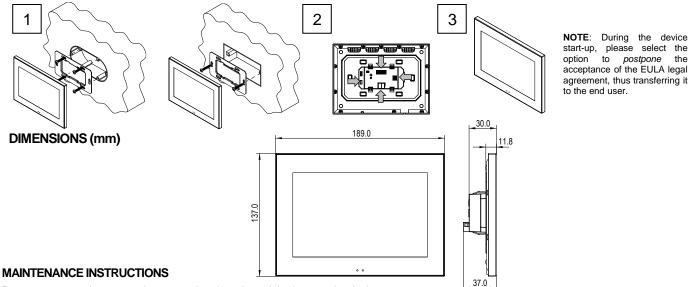

- Do not use aerosol sprays, solvents, or abrasives that might damage the device.
- Clean the product with a clean, soft, damp cloth.

SAFETY INSTRUCTIONS AND ADDITIONAL NOTES

- Installation should only be performed by qualified professionals according to the laws and regulations applicable in each country.
- Do not connect the mains voltage nor any other external voltage to any point of the KNX bus; it would represent a risk for the entire KNX system. The facility must have enough insulation between the mains (or auxiliary) voltage and the KNX bus or the wires of other accessories, in case of being installed.
- Keep the device away from water (condensation over the device included) and do not cover it with clothes, paper or any other material while in use.
- The WEEE logo means that this device contains electronic parts and it must be properly disposed of by following the instructions at https://www.zennio.com/en/legal/weee-regulation.
- This device contains software subject to specific licences. For details, please refer to http://zennio.com/licenses.