

### FEATURES

- 8 configurable outputs for 230 VAC valve control
- 8 thermostats
- 8 analog/digital inputs
- 10 logic functions
- Manual control through buttons and LED status indicators
- Common 230 VAC input supply for all the outputs
- Total data saving on KNX bus failure
- Integrated KNX BCU (TP1-256)
- Dimensions 67 x 90 x 70 mm (4 DIN units)
- DIN rail mounting according to IEC 60715 TH35, with fixing clamp
- Conformity with the CE, UKCA, RCM directives (marks on the right side)

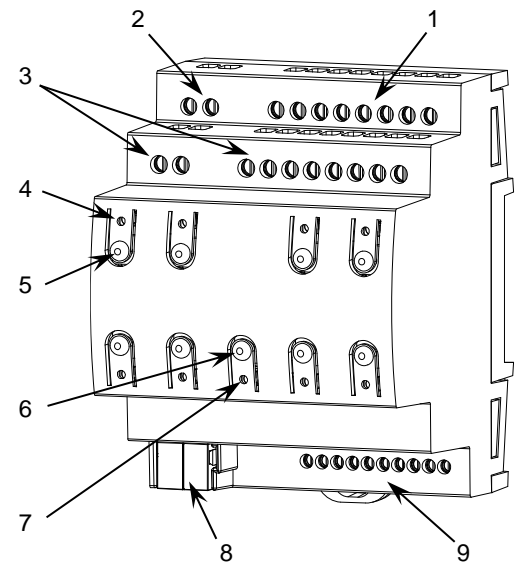


Figure 1: HeatingBOX 230V 8X v2

1. Valve outputs	2. 230 V input (phase)	3. 230 V input/output (neutral)	4. Output status LED	5. Output control button
6. Programming/Test Button	7. Programming/Test LED	8. KNX connector	9. Analog/Digital inputs	

Programming/Test button: short press to set programming mode. If this button is held while plugging the device into the KNX bus, it enters the safe mode. If this button is held for more than 3 seconds, the device enters the test mode.

Programming/Test LED: programming mode indicator (red). When the device enters the safe mode, it blinks (red) every half second. The manual mode is indicated by the green color. During the start-up (reset or after KNX bus failure) and if the device is not in safe mode, it emits a red flash.

### GENERAL SPECIFICATIONS

CONCEPT		DESCRIPTION		
Type of device		Electric operation control device		
KNX supply	Voltage (typical)	29 VDC SELV		
	Voltage range	21-31 VDC		
	Maximum consumption	Voltage	mA	mW
		29 VDC (typical)	12.9	374.1
24 VDC <sup>1</sup>	17,5	420		
Connection type		Typical TP1 bus connector for 0.8 mm Ø rigid cable		
External power supply		230 V 50/60 Hz		
Operation temperature		0 .. +55 °C		
Storage temperature		-20 .. +55 °C		
Operation humidity		5 .. 95%		
Storage humidity		5 .. 95%		
Complementary characteristics		Class B		
Protection class / Overvoltage category		II / III (4000 V)		
Operation type		Continuous operation		
Device action type		Type 1		
Electrical stress period		Long		
Degree of protection / Pollution degree		IP20 / 2 (clean environment)		
Installation		Independent device to be mounted inside electrical panels with DIN rail (IEC 60715)		
Minimum clearances		Not required		
Response on KNX bus failure		Data saving according to parameterization		
Response on KNX bus restart		Data recovery according to parameterization		
Operation indicator		The programming LED indicates programming mode (red) and test mode (green). Each output LED indicates its status (fixed=active output; flashing=overload or short-circuit). The blue blinking of the programming LED indicates a 3 minutes lock due to the suffering of 4 short-circuits/overloads in less than 3 minutes.		
Weight		181 g		
PCB CTI index		175 V		
Housing material / Ball pressure test temperature		PC FR V0 halogen free / 75 °C (housing) - 125 °C (connectors)		

<sup>1</sup> Maximum consumption in the worst-case scenario (KNX Fan-In model).

OUTPUTS SPECIFICATIONS AND CONNECTIONS		
CONCEPT	DESCRIPTION	
Number of outputs	8	
Output type	Solid state switching device	
Maximum recommended load per output (AC/DC)	Quantity of valves <sup>2</sup>	5
	Stationary current	200 mA (@ 35 °C)
	Maximum inrush current	2.5 A
Short-circuit protection	YES	
Overload protection	YES	
Connection method	Screw terminal block (0.4 Nm max.)	
Cable cross-section	0.5-2.5 mm <sup>2</sup> (IEC) / 26-12 AWG (UL)	

<sup>2</sup> It is allowed to connect up to 5 valves per output as long as the maximum stationary and inrush current of the output is not exceeded.

EXTERNAL POWER SUPPLY SPECIFICATIONS AND CONNECTIONS		
CONCEPT	DESCRIPTION	
Voltage	230 VAC 50/60 Hz	
Connection method	Screw terminal block (0.4 Nm max.)	
Cable cross-section	0.5-2.5 mm <sup>2</sup> (IEC) / 26-12 AWG (UL)	

INPUTS SPECIFICATIONS AND CONNECTIONS		
CONCEPT	DESCRIPTION	
Number of inputs	8	
Inputs per common	4	
Operation voltage	+3.3 VDC in the common	
Operation current	1 mA @ 3.3 VDC (per input)	
Switching type	Dry voltage contacts between input and common	
Connection method	Screw terminal block (0.2 Nm max.)	
Cable cross-section	0.5-1 mm <sup>2</sup> (IEC) / 26-16 AWG (UL)	
Maximum cable length	30 m	
NTC accuracy (@ 25 °C) <sup>3</sup>	±0.5 °C	
Temperature resolution	0.1 °C	
Maximum response time	10 ms	

<sup>3</sup> For Zennio temperature probes.

## WIRING DIAGRAM


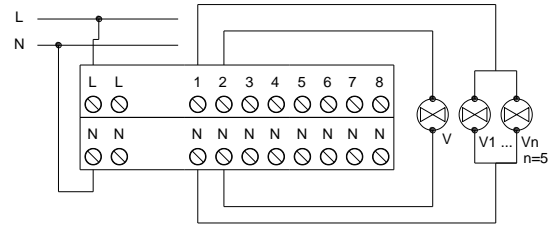


Figure 2: Wiring example: one valve per output and several valves per output.

⚠ Simultaneous connection of one valve to several outputs is not allowed.

## INPUTS CONNECTION

Any combination of the following accessories is allowed in the inputs:

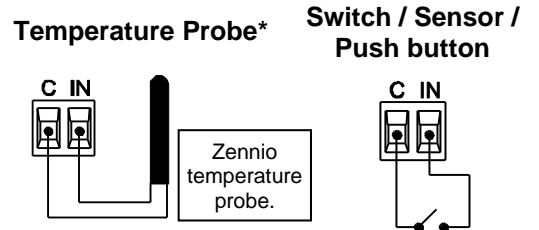

⚠ Commons of different devices must not be connected together.

\* Zennio temperature probe or any NTC with known resistance values at three points in the range [-55, 150 °C].

ERROR	VISUAL NOTIFICATION	
Short circuit on V1		
Overload on V1-V4 group*		
Lock due to short circuit / overvoltage		

\* Error notification is similar for output group V5-V8.

## SAFETY INSTRUCTIONS AND ADDITIONAL NOTES

- Installation should only be performed by qualified professionals according to the laws and regulations applicable in each country.
- Do not connect the mains voltage nor any other external voltage to any point of the KNX bus; it would represent a risk for the entire KNX system. The facility must have enough insulation between the mains (or auxiliary) voltage and the KNX bus or the wires of other accessories, in case of being installed.
- The facility must be equipped with a device that ensures the omnipolar sectioning. Installation of a 10 A mini-circuit-breaker is recommended. To prevent accidents, it must remain open in case of manipulation of the device.
- Once the device is installed (in the panel or box), it must not be accessible from outside.
- Keep the device away from water (condensation over the device included) and do not cover it with clothes, paper or any other material while in use.
- The WEEE logo means that this device contains electronic parts and it must be properly disposed of by following the instructions at <https://www.zennio.com/en/legal/weee-regulation>.
- This device contains software subject to specific licences. For details, please refer to <https://zennio.com/licenses>.